


TEPLOTY PRIMÁRNÝCH ROZVODOV NA VÝSTUPE ZO ZDROJA TEPLA (MH Teplárenský holding a.s., závod Žilina)

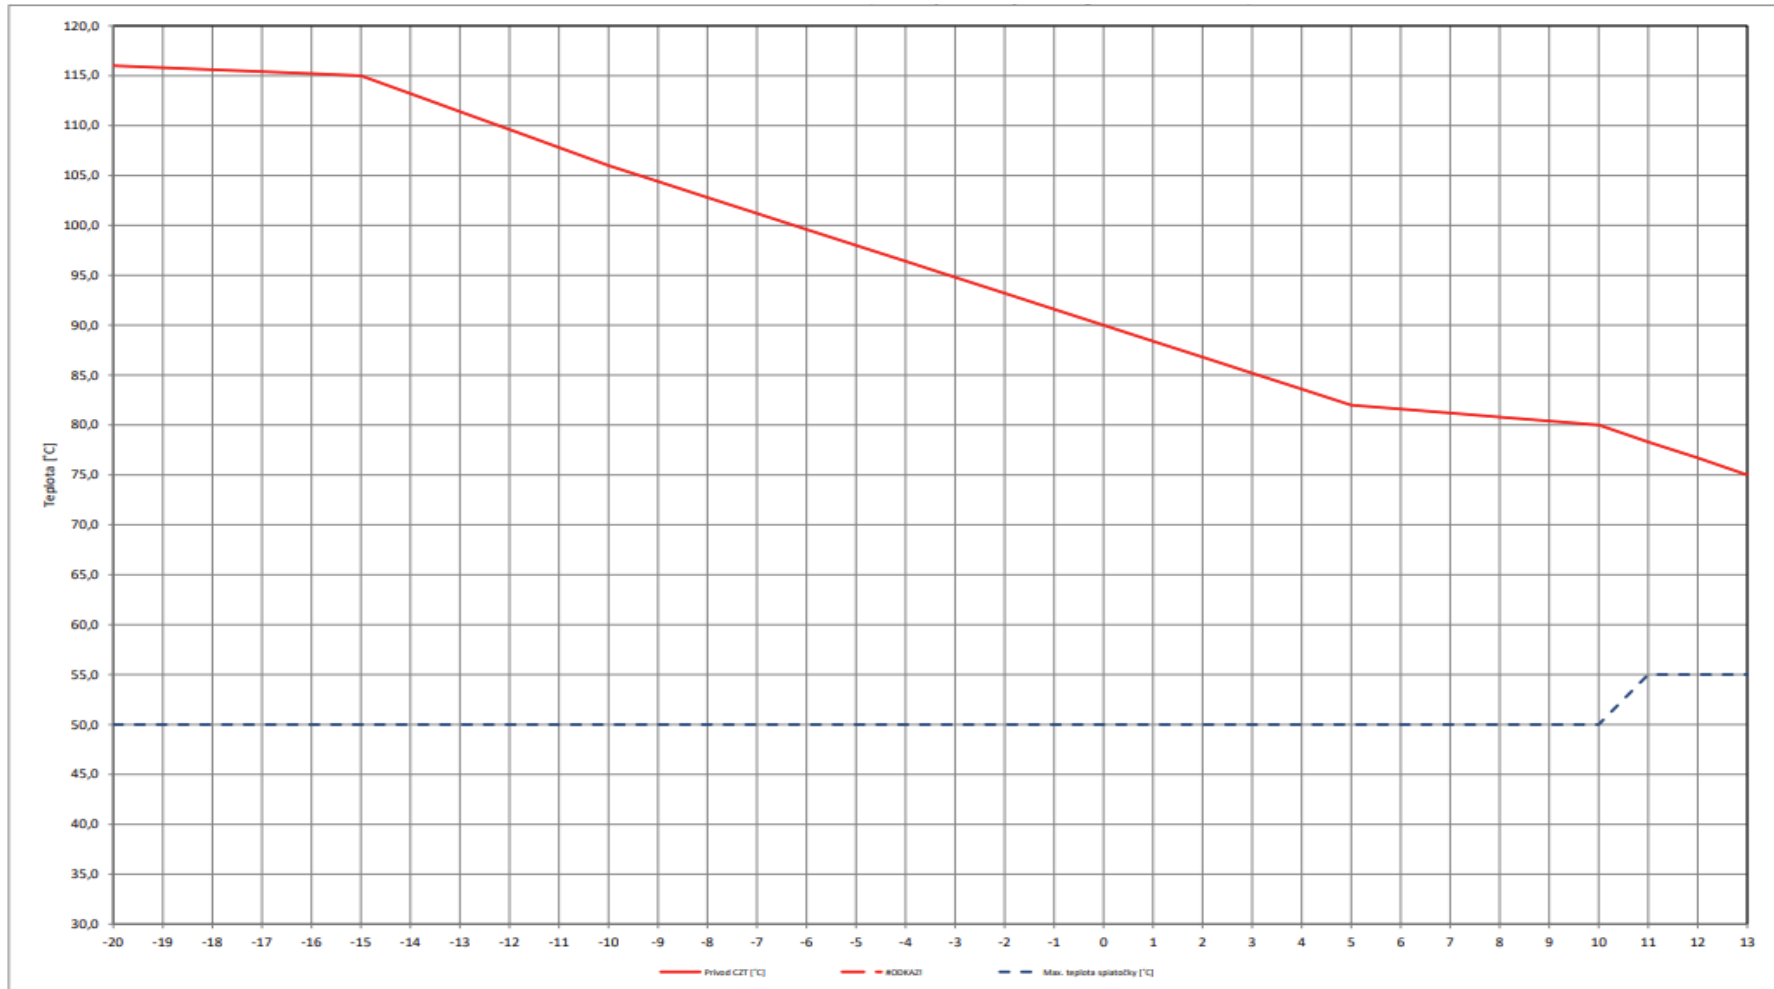

Vonkajšia teplota $t_a$ [°C]	-20	-19	-18	-17	-16	-15	-14	-13	-12	-11	-10	-9	-8	-7	-6	-5	-4	-3	-2	-1	0	1	2	3	4	5	6	7	8	9	10	11	12	13
Prívod CZT [°C]	116,0	115,8	115,6	115,4	115,2	115,0	113,2	111,4	109,6	107,8	106,0	104,4	102,8	101,2	99,6	98,0	96,4	94,8	93,2	91,6	90,0	88,4	86,8	85,2	83,6	82,0	81,6	81,2	80,8	80,4	80,0	78,3	76,7	75,0
Max. teplota späťochy [°C]	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	50,0	55,0	55,0	55,0	